

DISTANCE FROM STRUCTURES AND/ OR PROPERTY LINES

TENTS UNDER 1,500 SQUARE FEET – 10'
TENTS 1,501 – 15,000 SQUARE FEET – 30'
TENTS OVER 15,000 SQUARE FEET = 50'

DISTANCE FROM BRUSH

ALL TENTS MUST BE A MINIMUM OF 30' FROM SURROUNDING BRUSH OR DRY GRASS.

PARKING

NO PARKING WITHIN 50' OF TENT. EXCEPTIONS MUST BE APPROVED BY THE FIRE DEPT.

EXIT DOORS

ONE EXIT FOR EVERY 800 SQUARE FEET.
EXITS SHOULD BE ON BOTH SIDES OF THE TENTS.
ILLUMINATED EXITS SIGNS TO BE PROVIDED.

NO SMOKING SIGNS

ONE NO SMOKING SIGN FOR EVERY 400 SQUARE FEET.

FIRE EXTINGUISHERS

ONE 2A10BC FIRE EXTINGUISHER FOR EVERY 800 SQUARE FEET.


HEATING/COOKING

NO OPEN FLAME INSIDE OF THE TENT. STERNO FOR WARMING FOOD IN CHAFFING DISHES ONLY. PROPANE HEATERS MUST BE A MINIMUM OF 10' FROM THE TENT.
WITH THE PROPANE TANK IN A CRATE OR OTHER APPROVED DEVICE TO KEEP IT FROM FALLING OVER OR SECURED WITH A STAKE.


IF FOR ANY REASON ONE OF THE FOLLOWING FIRE CODES CAN NOT BE MET, PLEASE CONTACT THE LOCATION MANAGER IMMEDIATELY AND EXPLAIN THAT THE TENT MUST EITHER BE MOVED TO ANOTHER LOCATION OR THAT THE APPROPRIATE STEPS MUST BE TAKEN BEFORE THE TENT IS ERECTED IN THAT LOCATION.

PROPER TENT PIN – cannot become dislodged

IMPROPER TENT PIN – 16 penny nail- head can become dislodged or fall out,
Smaller sized nails can be cut or break with pole movement.

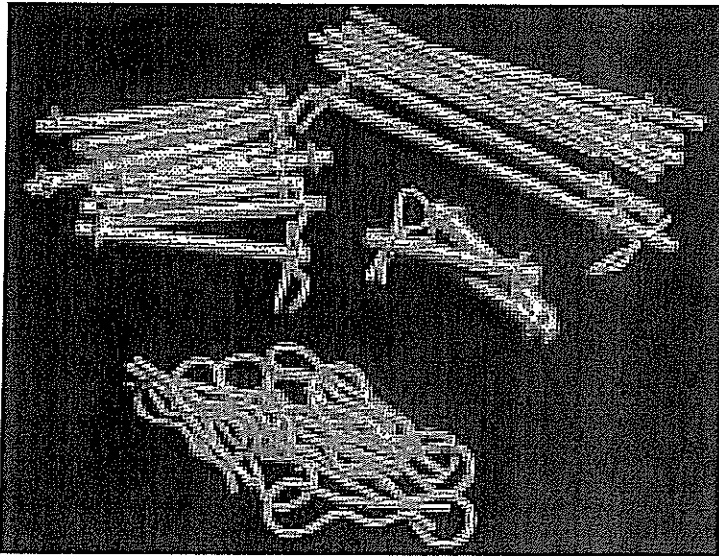

Manufacturer Approved Locking Pins

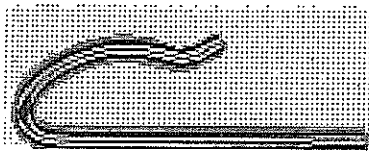

The J-Style canopy pin provide economical, quick and easy to secure frame to fittings



The 2" double loop wire pin provide more permanent fit and better resistant to vibration.

